


NOTES:

1. IF ROADSIDE DITCH IS PRESENT A 15" RCP (MINIMUM) DRIVEWAY CULVERT IS REQUIRED UNLESS PLOT PLAN SPECIFIES OTHERWISE.
2. CHECK DAMS ARE REQUIRED IN AREAS OF CONCENTRATED FLOW.
3. CONSTRUCTION ENTRANCE IS REQUIRED. STONE PAD MUST BE CONSTRUCTED FROM CLEAN, WASHED STONE WITH A 2-4 INCH GRADATION AND A MINIMUM THICKNESS OF 8 INCHES. STONE PAD MUST BE A MINIMUM OF 20' WIDE AND 50' LONG (OR EXTEND TO THE PROPOSED FOOTERS).
4. SILT FENCE MUST BE INSTALLED AROUND DISTURBED PERIMETER. INSTALL IN J-HOOK PATTERN WHERE NOT ON CONTOUR WITH EXISTING GRADE. SILT FENCE SHALL NOT BE INSTALLED ACROSS STREAMS, DITCHES, WATERWAYS, OR OTHER CONCENTRATED FLOW AREAS.
5. AREA DRAINS NEED A ROCK FILTER RING AND BE INSTALLED PER TDEC REQUIREMENTS.
6. CONCRETE WASHOUTS MUST BE INSTALLED AWAY FROM ANY DRAINS, INLETS, OR OUTFALLS OF SITE. CONCRETE MUST BE WASHED OUT IN DESIGNATED AREA.
7. STABILIZATION: ONCE GRADING ON ANY PORTION OF THE SITE HAS REACHED FINAL GRADE, TOPSOIL MUST BE SPREAD PRIOR TO FINAL STABILIZATION. APPLY NATIVE GRASS SEED AT A MINIMUM RATE OF 150 LBS/ACRE. APPLY STRAW AT RATE OF 2 TONS PER ACRE. SLOPES AND DITCHES MUST HAVE STRAW MATTING.
8. ALL EPSC MEASURES MUST BE MAINTAINED THROUGHOUT CONSTRUCTION.
9. ALL DISTURBED AREAS MUST BE STABILIZED WITHIN 14-DAYS OF INACTIVITY.
10. ANY ILLICIT DISCHARGE OR OTHER STORM WATER VIOLATIONS MAY RESULT IN IMMEDIATE STOP-WORK-ORDERS AND/OR CIVIL PENALTIES UP TO \$5,000 / DAY.
11. FOR CRITICAL LOTS, REFER TO EPSC MEASURES SHOWN IN CRITICAL LOT PLAN APPROVED BY LEBANON ENGINEERING DEPARTMENT.



DRIVEWAY PERMIT WILL NOT BE ISSUED UNTIL AFTER ALL ITEMS ARE INSTALLED PER TDEC EPSC HANDBOOK REQUIREMENTS. CONTACT: BENJI FREELS (615-519-8901) OR LOGAN CARTER (615-946-9850) FOR INSPECTION BUILDING PERMIT WILL NOT BE ISSUED UNTIL DRIVEWAY PERMIT IS ISSUED

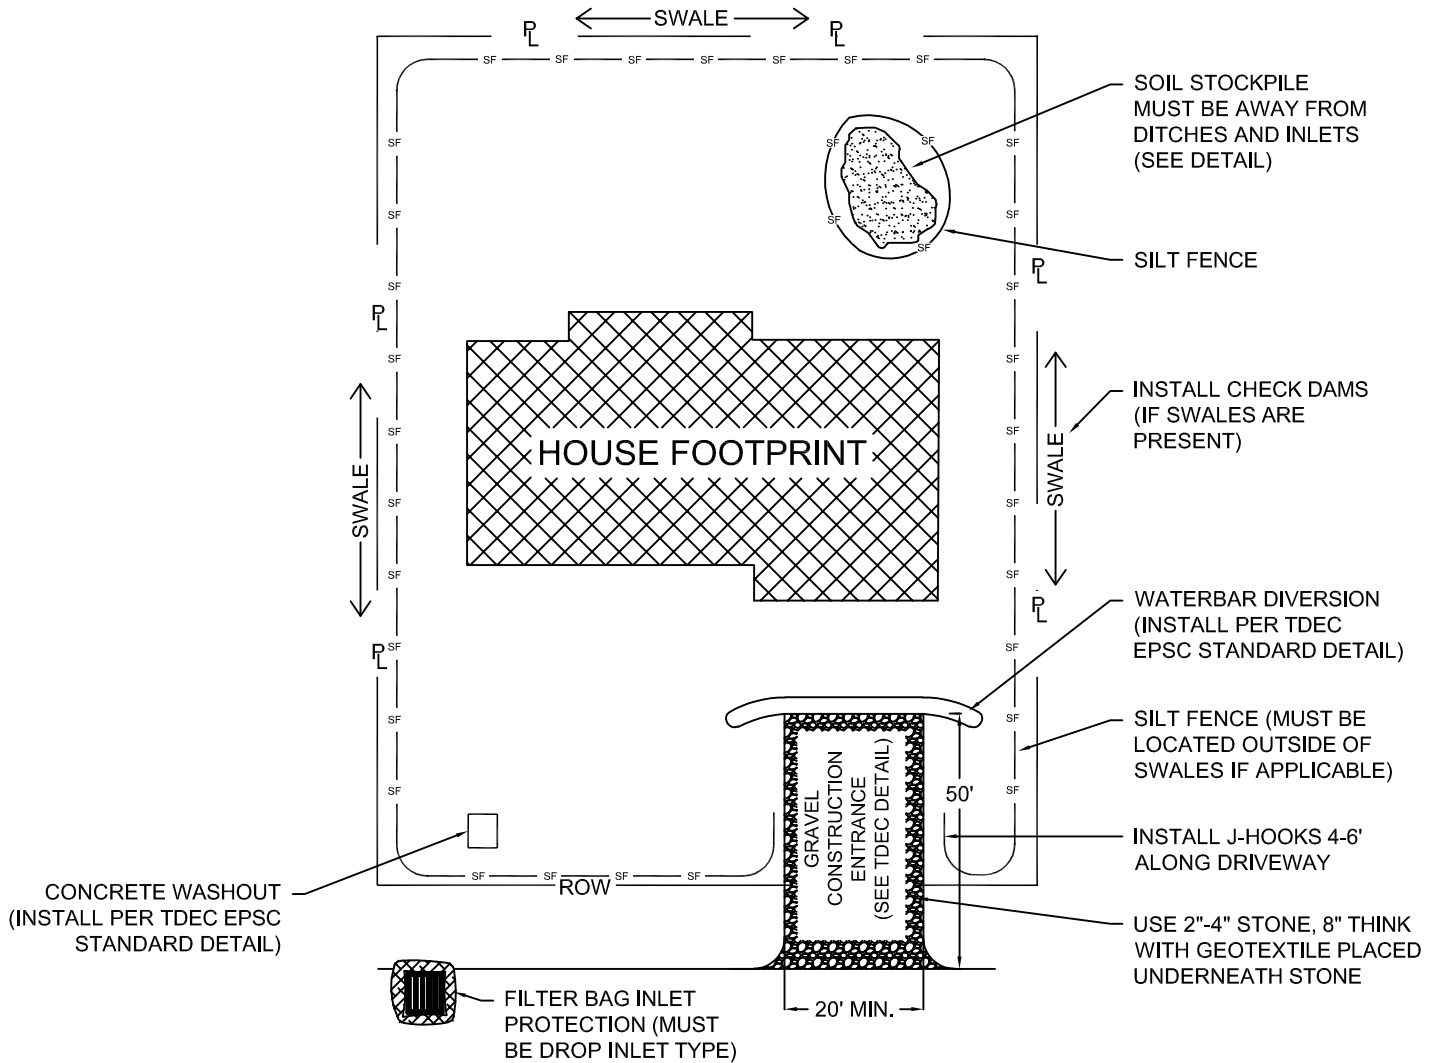

ENGINEERING DEPARTMENT

RESIDENTIAL - INDIVIDUAL LOT EPSC REQUIREMENTS